



SINGLE SERVICE

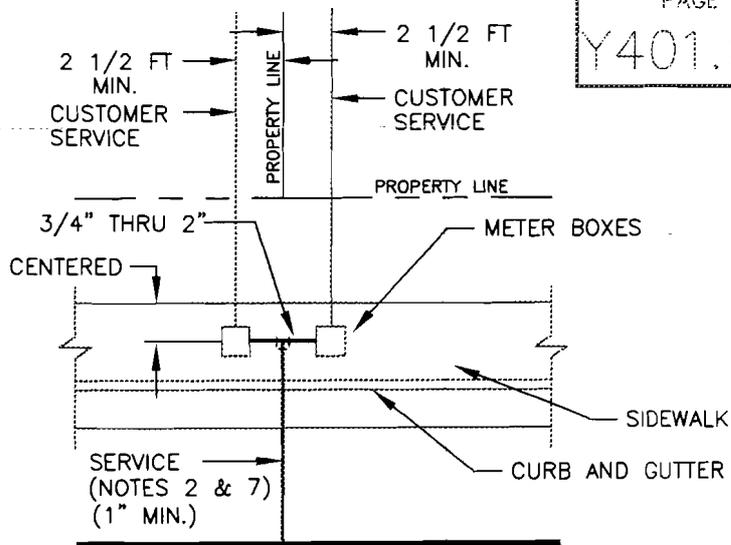

DOUBLE SERVICE

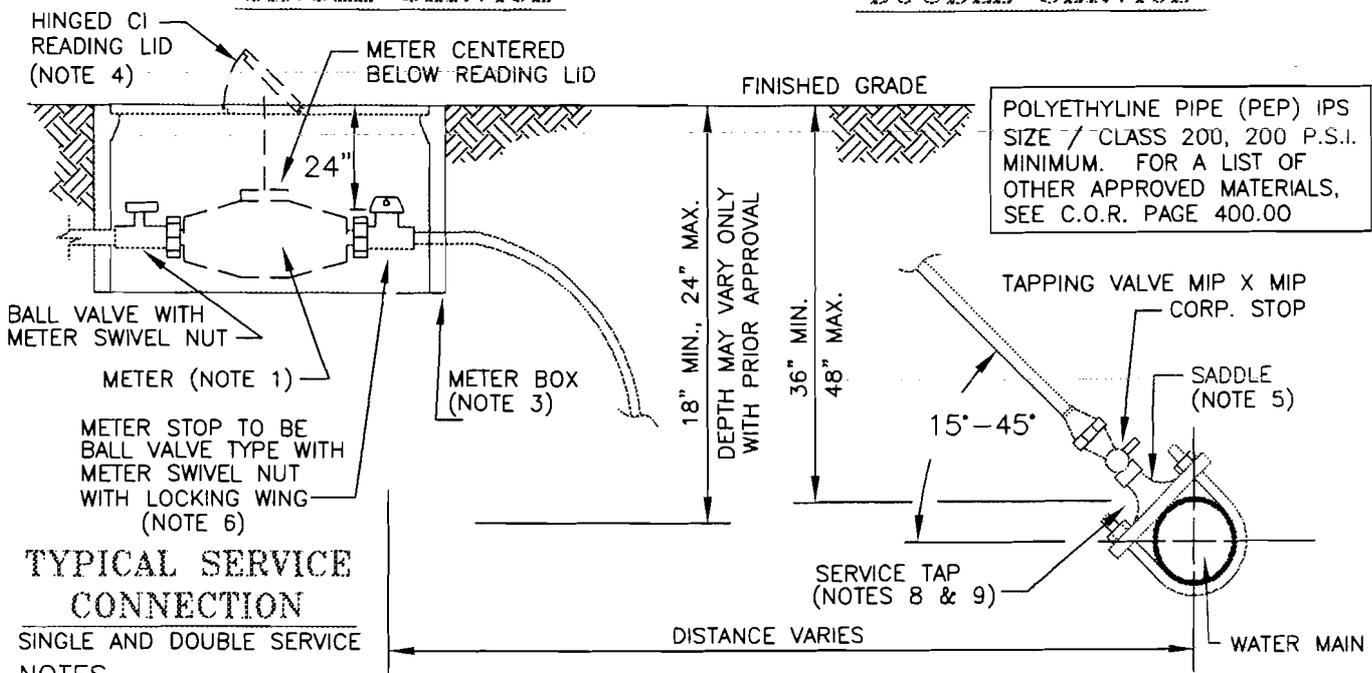


POLYETHYLENE PIPE (PEP) IPS SIZE 7 CLASS 200, 200 P.S.I. MINIMUM. FOR A LIST OF OTHER APPROVED MATERIALS, SEE C.O.R. PAGE 400.00

TYPICAL SERVICE CONNECTION

SINGLE AND DOUBLE SERVICE NOTES

1. METER SIZES SHALL BE 5/8" x 3/4", THRU 2".
2. SERVICE PIPE AND COUPLINGS PER THIS STANDARD AND/OR MATERIALS LIST, ITEM 1, PAGE 400.00.
3. METER BOXES SHALL BE PER MATERIALS LIST, ITEM 6, PAGE 400.00.
4. METER BOXES SHALL HAVE CONCRETE LIDS (STEEL TRAFFIC LIDS IN DRIVEWAYS OR AREAS WITH ROLL CURB) WITH HINGED CI. READING LIDS. SEE MATERIALS LIST, ITEM 6, PAGE 400.
5. SADDLES PER MATERIALS LIST, ITEM 3, PAGE 400.00.
6. METER STOP VALVE SHALL BE POSITIONED IN METER BOX SO THAT METER REGISTER WILL BE CENTERED UNDER READING LID.
7. METER BOXES AND SERVICE PIPING SHALL BE INSTALLED WITH A MINIMUM OF 2 1/2 FT. CLEARANCE FROM ALL ELECTRICAL TRANSFORMERS, LIGHT STANDARDS AND OTHER UTILITY BOXES OR VAULTS.
8. ONLY SERVICE TAPS FOR 1 1/2" AND 2" MAY BE TAPPED OTHER THAN AT A 45° ANGLE, BUT ONLY WITH PRIOR APPROVAL OF THE CITY ENGINEER.
9. SERVICE TAPS 3/4" THRU 2" SHALL BE INSTALLED A MIN. OF 24" FROM END OF PIPE OR FITTINGS.
10. A DOUBLE CHECK VALVE SHALL BE INSTALLED ON THE PROPERTY SIDE OF THE METER WHENEVER A PRIVATE WELL OR DEVELOPED SPRING IS LOCATED ON THE PROPERTY BEING SERVED.
11. PAGE NUMBERS IN THESE NOTES REFER TO CITY OF REDDING CONSTRUCTION STANDARDS

DWG DATE 6-05	SCALE NTS	CITY OF YREKA • DEPARTMENT OF PUBLIC WORKS	
		APPROVED BY  STEVEN D. NEILL, P.E. RCE #33385 DIRECTOR OF PUBLIC WORKS	<h2 style="margin: 0;">WATER SERVICE CONNECTION</h2> <p style="margin: 0;">SINGLE / DOUBLE 3/4" THRU 2"</p>
MARK	DATE	REVISION	